

Criticality Study for Large Masses of Low Enriched Uranium Samples in an Active Well Neutron Coincidence Counter

ABSTRACT

A criticality study has been conducted while verifying large masses of Low Enriched Uranium (LEU) samples in an Active Well Neutron Coincidence Counter (AWCC). Fissile material mass limits were determined for some setup conditions to assure safe operation of the counter. The work was performed at the Department of Safeguards and Physical Protection, Nuclear and Radiological Regulatory Authority (ENRRA), during the period from February to December 2015.

The AWCC device was assumed to be employed in verification activities including measurements of different Nuclear Material (NM) samples in different setup configurations, forms and conditions. The MCNP5 code was used to estimate k_{eff} of relatively large masses of LEU in different forms including uranium oxide powder, compacts and fuel rods. All calculations were performed assuming the operation of the AWCC in active thermal mode at maximum capacity of its cavity. The uranium powder samples were modeled as dry and with different values of water contents. For compacts and fuel rods, the calculations were performed with and without the existence of moderating materials in the cavity of the device.

All studied cases were found to be subcritical except for a few cases of uranium oxide powder containing water. Criticality was reached for samples containing ^{235}U masses ranged between 1.5 to 8.0 kg with corresponding percent water content from 67 to 25. The estimated mass limits of LEU samples with certain characteristics that could be safely verified in the device are presented.

Keywords: Criticality, Safeguards, AWCC, Uranium, Monte Carlo

1. INTRODUCTION

Inspection on nuclear facilities for safeguards purposes is one of the main functions of a nuclear regulator. Usually, the inspection activities include the performance of some measurements to verify the declared quantities of Nuclear Materials (NM). Sometimes the inspection activities should be performed while facility shutdown, which necessitates minimizing the time of inspection to avoid any delay or interruption to facility operation. The optimum goal of an inspection is to verify all NM in a relatively short time. However, in most cases, this could not be achieved due to either limitations in time or the presence of large number of items, and representative sample has to be selected. The probability of detection of diversion or inconsistency increases as the quantity or the number of items in representative sample increases [1]. The AWCC - member of the neutron coincidence family [2, 3] - can provide essential solutions for these situations. It is designed to measure the NM non-destructively. The device was not only used for many applications, efforts have been done to improve its use as well [4-8]. The components, operation and characteristics of the AWCC were described in many articles [9-16]. A recognized advantage of the AWCC is that it could accommodate relatively large masses or large number of items of NM. Accordingly, it can be efficiently used to achieve inspection goals with relatively higher accuracy and short time. However, the selection of large NM samples may raise the issue of criticality. Therefore, criticality checks have to be carried out to assure safe operation. To our best knowledge, criticality calculations for the AWCC were performed for High Enriched Uranium (HEU) samples [17-19]. The present study aimed to perform criticality calculations for relatively large masses of Low Enriched Uranium (LEU) samples measured in the AWCC using the general Monte Carlo Code MCNP5.

2. CALCULATIONS

Criticality calculations were performed for different NM samples in the AWCC. The samples include uranium oxide powder, NM compacts and nuclear fuel rods. All calculations were performed assuming thermal mode operation of the AWCC. Also, the maximum capacity of the counter was considered. The maximum capacity is achieved via removing the upper and lower polyethylene plugs except for modified polyethylene disks in which the interrogation sources are placed. With this setup the volume of the cavity is about 19.3 ℓ.

2.1 Modeled samples

Homogeneous dry- and moisture contained-powder samples of U_3O_8 compound were modeled. Nine density values were considered for the dry U_3O_8 samples covering a range starts from 1 up to the theoretical density (D_T) of 8.3 g/cm³. At the maximum capacity of the AWCC cavity (19.3 ℓ) these densities correspond to a range of U_3O_8 masses between 19.29 and 160.11 kg respectively. The uranium enrichment for both powder and compact samples is about 19.77%. As a safety margin an enrichment of 20% was assumed for U_3O_8 powder samples (noted later by $U_3(20)O_8$). For NM-water mixtures eleven samples were considered. At the maximum volume of sample cavity, the modeled samples contain U_3O_8 masses range between 4.823 to 154.323 kg with a corresponding range of water content between 79.51 to 0.45 percent by weight, respectively.

Compact samples are mixtures of U_3O_8 and Aluminum compressed in a cuboid form. They are used for manufacturing nuclear fuel of MTR type. Each compact has dimensions of 6.90×6.05×0.85 cm, density equal to 4.84 g/cm³ and contains 21.30 g of ²³⁵U isotope.

The EK-10 fuel rods contain LEU (10% enrichment) with a matrix material. In the present study, these rods were assumed to contain pure uranium with 11.112 g ²³⁵U isotope mass content per fuel rod. The dimensions of the rod are 50.0 cm length and 0.7 cm diameter. The cladding material is Aluminum (0.15 cm thickness).

For compacts and fuel rods cases, the calculations were performed with and without moderation materials fill the spaces between items in the cavity of the counter. The existence of moderating material in the cavity was considered for two reasons. First, is to take into consideration the worst possibility of flooding with water. Second, polyethylene (C₂H₄) may be used as a moderating material especially for LEU samples that may contain relatively small masses of ²³⁵U. The presence of C₂H₄ increases the fission rates and improves the counting statistics via increasing the fraction of thermal neutrons.

2.2 Modeling

Calculation of k_{eff} for all configurations was performed using the general Monte Carlo Code MCNP5 [20, 21]. "KCODE" card was used to run criticality problems with "KSRC" card to locate the initial spatial distribution of fission points. Initial fission source points were located in every cell containing fissionable material. The initial guess of k_{eff} was determined according to each problem. A nominal number of source histories was selected as 5000 per cycle. Fifty source cycles were skipped before k_{eff} accumulation, while 250 active cycled were considered. To find out the optimal number of histories and cycles several runs were performed and the results were checked against the relative standard deviation. The optimal numbers were chosen such that the estimated relative standard deviations were always below 0.25% for all calculations.

The "LIKE n BUT" feature was used to create repeated structure of ³He tubes in the counter and that for compacts, while "U" (universe), "FILL" and "LAT=2" (lattice, hexagonal prism) cards were used to create the repeated structure of fuel rods.

Fig.1 illustrates the longitudinal and cross section calculations model geometries for U_3O_8 powder samples as drawn by MCNP5 visual editor. The cavity of the counter is completely filled with NM.

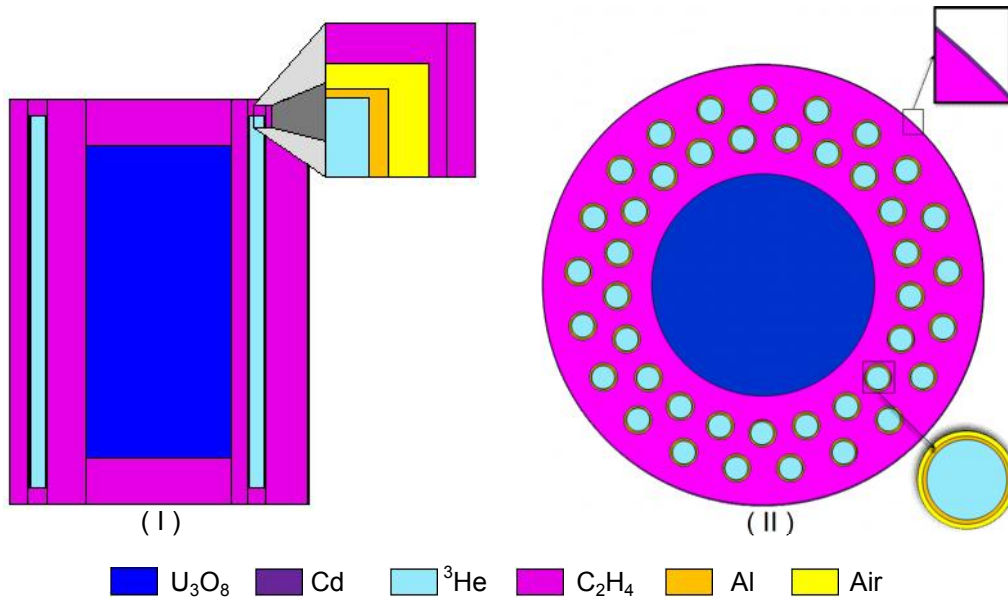


Fig. 1. MCNP calculations model geometries for U_3O_8 powder samples (I) longitudinal and (II) cross section.

Two configurations for the compacts in the counter were modeled. In the first one the compacts were staked to approximately fill the cavity of the counter with a total uranium mass of 31.2 kg. In the second configuration 125 compacts with a total uranium mass of 13.515 kg were regularly distributed in the cavity with spacing in between as shown in Fig. 2. In both cases the rest volume of the cavity was assumed to be filled with a moderating material.

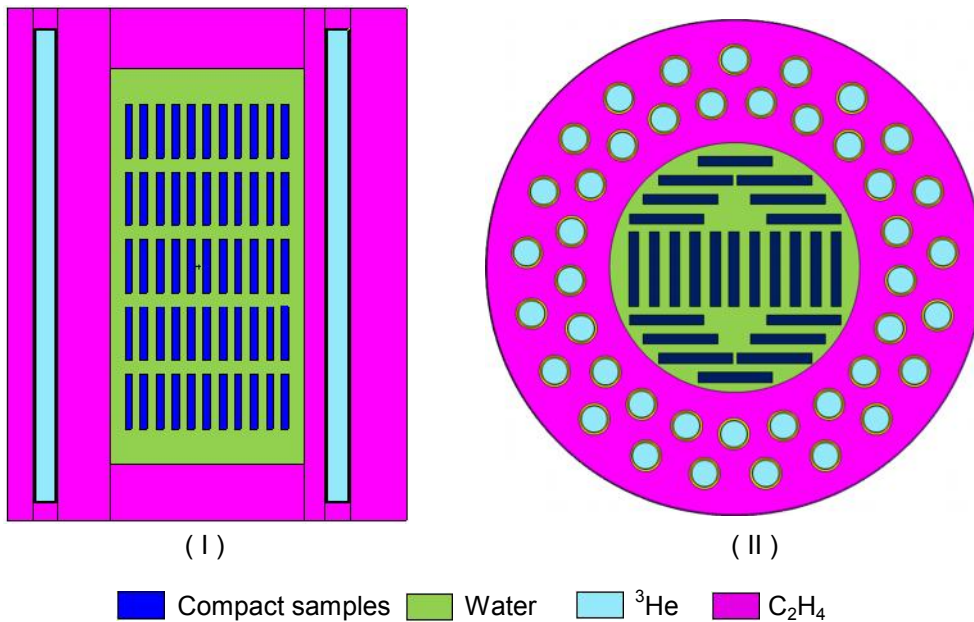


Fig.2. MCNP calculations model geometries for regularly distributed compact material samples (I) longitudinal and (II) cross section.

For fuel rods many configurations were modeled including different number of fuel rods (^{235}U -mass), regular and irregular distributions. Twenty seven cases were modeled in the present work as presented in Table 1. Each case is identified by two characters; the first is a letter indicating the moderating material while the second is a numeric indicating the number of fuel rods arranged at a certain configuration as illustrated in Fig 3. The figure illustrates only the nine cases without moderating materials.

Table 1. Codes for different cases of criticality calculations of fuel rods in the AWCC

NR [*] →	73	91	100	113	127	150	188	200	361
CM ⁺ ↓									
None	N1	N2	N3	N4	N5	N6	N7	N8	N9
Water	W1	W2	W3	W4	W5	W6	W7	W8	W9
C ₂ H ₄	P1	P2	P3	P4	P5	P6	P7	P8	P9
^{235}U mass (g)	811.0	1011.2	1111.2	1255.7	1411.2	1666.8	2089.0	2222.4	4011.4

*NR: Number of Fuel Rods distributed as illustrated in Fig. 3

*CM: Moderating material in the cavity

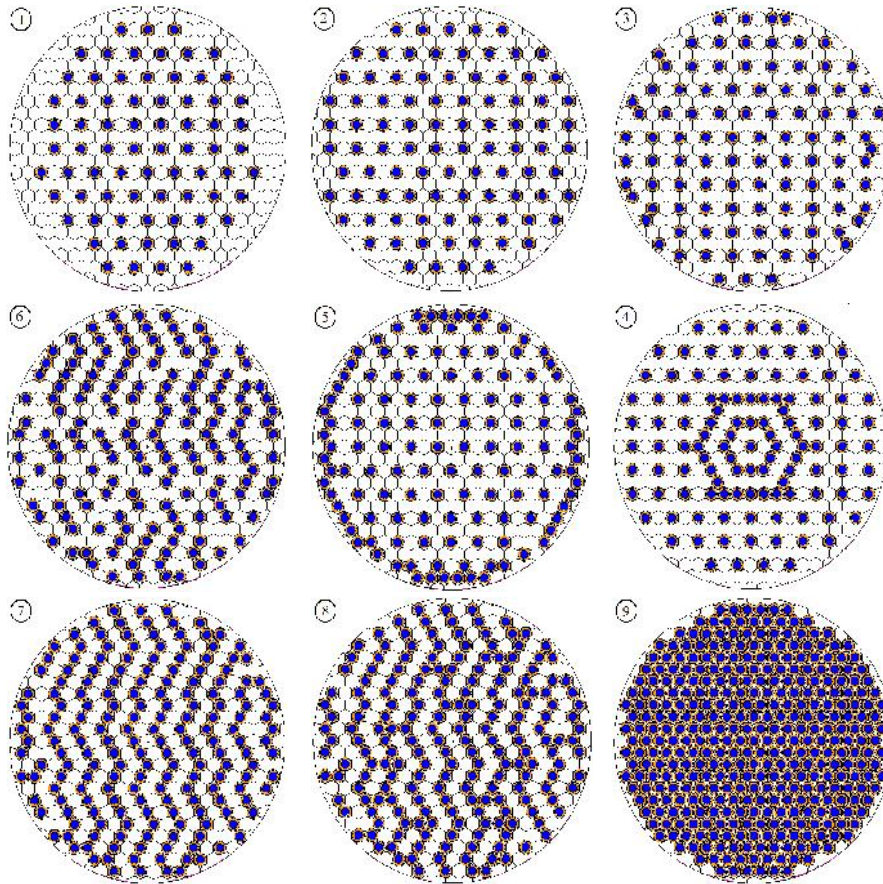


Fig. 3. Fuel rods distributions for Nine configurations.

Fig. 4 shows the MCNP model for case N5 as a selected configuration for irregular distribution of 127 fuel rods without moderating material. A regularly distributed fuel rods configuration model (case W1), in which the moderating material is water, is shown in Fig. 5. Another selected configuration (case P9) is shown in Fig. 6. It indicates that the number of fuel rods is 361 (the maximum capacity of the counter) with polyethylene moderating material.

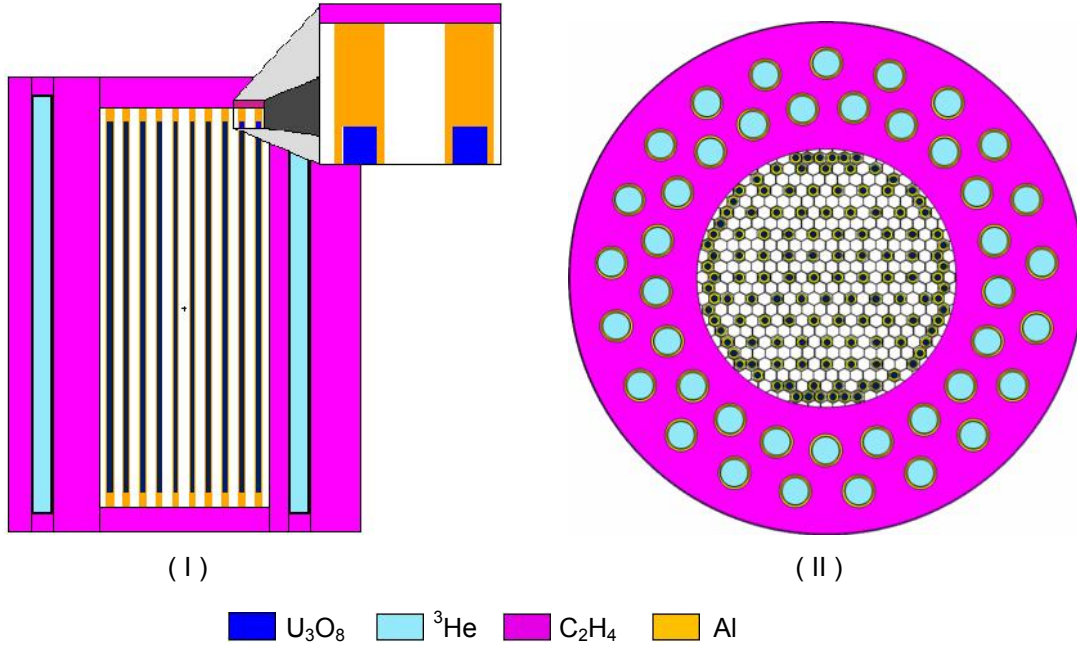


Fig. 4. MCNP longitudinal (I) and cross (II) section Calculation model geometries for irregular distribution of fuel rods without moderating material (case N5).

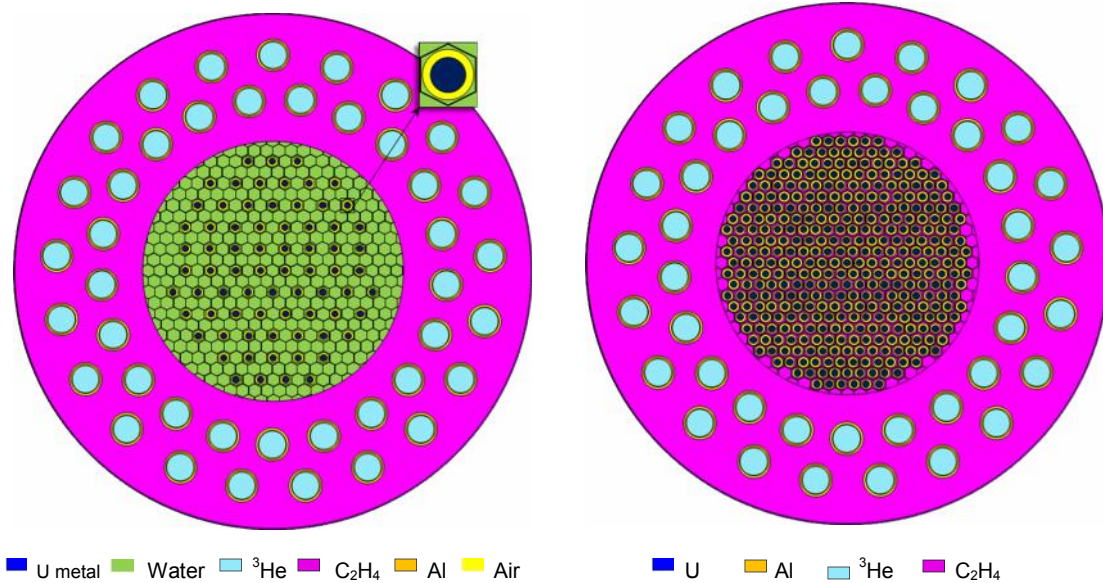


Fig. 5. MCNP model for regularly distributed fuel rods with water as moderating material (case W1).

Fig. 6. MCNP model for case P9, full capacity of cavity with polyethylene moderating material.

4. RESULTS AND DISCUSSION

Table (2) presents the calculated k_{eff} values for LEU dry powder samples. All samples are far subcritical even for the maximum weight at the U_3O_8 theoretical density. As uranium mass (density) increases more fissions are expected to take place due to increase in interaction cross section [3]. A direct proportionality is noticed between U_3O_8 mass and k_{eff} , however it is not linear. This is due to the reason that the produced fission neutrons will directly interact with uranium nuclide without having enough chance for being thermalized. This is clear from the last three columns in the Table (2) which gives the percent of fission neutrons caused by thermal (Th , <0.625 eV), intermediate (Int , 0.625 eV- 100 keV) and fast (F , >100 keV) neutrons as calculated and given by the MCNP5 Code. Consequently the rate of increase of calculated k_{eff} values will decrease as uranium mass increases. The maximum calculated k_{eff} value (0.65) is limited by the maximum U_3O_8 density (D_T) and the size of the AWCC cavity.

Table 2. Values of k_{eff} for dry $U_3O_8(20)$ powder with varying mass

U_3O_8 (kg)	^{235}U (g)	Sample density (g/cm ³)	k_{eff}	Percent of fissions caused by neutrons		
				Th	Int	F
19.290	3272	1	0.36	76	15	9
38.581	6543	2	0.42	65	21	14
57.871	9815	3	0.46	57	24	19
77.162	13087	4	0.50	52	25	23
96.452	16358	5	0.54	47	26	27
115.742	19630	6	0.57	44	26	30
135.032	22902	7	0.61	41	26	33
154.323	26173	8	0.64	38	27	35
160.110	27154	8.3	0.65	37	27	36

The obtained values at half (D_h) and full (D_f) theoretical density are comparable with those obtained by Miller and Yearwood [19], although some differences exist in calculation conditions. The differences include material compositions, values of D_h and D_f and ^{235}U enrichment. Table 3 presents some selected k_{eff} values obtained by Miller and Yearwood in comparison with those obtained in this study with specific differences in calculation conditions.

Table 3. Comparison of some k_{eff} selected values obtained in this work with those obtained by Miller and Yearwood (with specific differences in calculation conditions).

	NM	^{235}U Enr	D_T (g/cm ³)	k_{eff} at D_h	k_{eff} at D_f	k_{eff} $\frac{\quad}{5\text{ kg, }^{235}\text{U}}\quad\frac{\quad}{10\text{ kg, }^{235}\text{U}}$	
Miller & Yearwood	UO ₂	93%	11.0	Ranges between		0.44	0.63
				0.44 - 0.55	0.50 - 0.63		
				for ^{235}U masses between 5 and 10 kg			
This work	U ₃ O ₈	20%	8.3	0.52 ~ 14.5 kg ^{235}U mass	0.64 ~ 27.2 kg ^{235}U mass	0.39 $\rho\sim 1.5\text{ g/cm}^3$	0.46 $\rho\sim 3\text{ g/cm}^3$

In Table (4), the values of calculated k_{eff} are given on a range of homogeneous mixtures of water and U_3O_8 powder. As the fraction of water content increases (increase in Hydrogen mass fraction "H" as

indicated in the last column of the Table), more thermal neutrons becomes available to induce more fissions. Samples remain subcritical till water content reaches about 25% by weight in the sample. Then, they sample become and remain critical as the water content increases till about 65% by sample weight. As the water content is increased more, the effects due to decrease in the mass of fissile material and increase in neutron capture by Hydrogen predominates and the system becomes again subcritical. The range at which the samples becomes critical, as given in Table (4), is between about 1.5 and 8 kg of ^{235}U mass which corresponds to about 65 and 25% water contents, respectively. The trend of increasing and then decreasing of k_{eff} as water content in the sample increase is in consistent with that obtained in other literature [19].

Table 4. Values of k_{eff} for $\text{U}_3\text{O}_8(20)$ powder with varying mass and water content.

U_3O_8 (kg)	^{235}U (g)	Weight percent Water in sample	Sample density (g/cm ³)	k_{eff}	Percent of fissions caused by neutrons			H-mass fraction (%)
					<i>Th</i>	<i>Int</i>	<i>F</i>	
154.323	26173	0.45	8.036	0.67	37	31	32	0.05
135.032	22902	2.19	7.157	0.72	37	39	24	0.24
115.742	19630	4.41	6.277	0.77	41	42	17	0.49
96.452	16358	7.37	5.398	0.83	48	39	13	0.82
77.162	13087	11.47	4.518	0.88	57	34	9	1.27
57.871	9815	17.55	3.639	0.94	67	27	6	1.95
48.226	8179	21.85	3.199	0.97	73	22	5	2.43
38.581	6543	27.51	2.759	1.00	78	18	4	3.06
19.290	3272	46.79	1.880	1.03	88	10	2	5.20
9.645	1636	65.27	1.440	0.99	94	5	1	7.25
4.823	818	79.51	1.220	0.87	96.5	3	0.5	8.83

As reflected in Table 5, calculations for compact NM indicate fairly safe values for staked compact samples even for full capacity of counter and moderation materials. However, caution should be considered for distributed samples with polyethylene moderating material (last raw in the Table 5) which correspond to a number of samples of 125 (about 2.7 kg of ^{235}U).

Table 5. Values of k_{eff} for U-compacts in different configurations and cavity moderators.

Case	^{235}U mass (g)	Cavity moderator	k_{eff}	Percent of fissions caused by neutrons		
				<i>Th</i>	<i>Int</i>	<i>F</i>
1	6147	None	0.39	61	19	20
		Water	0.51	63	21	16
		Poly	0.53	64	21	15
2	2662.5	None	0.35	76	14	10
		Water	0.85	85	12	3
		Poly	0.94	87	10	3

Fig 7 shows the results of calculations for fuel rod cases. The values of k_{eff} are drawn for device cavity without moderating material, with water and with polyethylene.

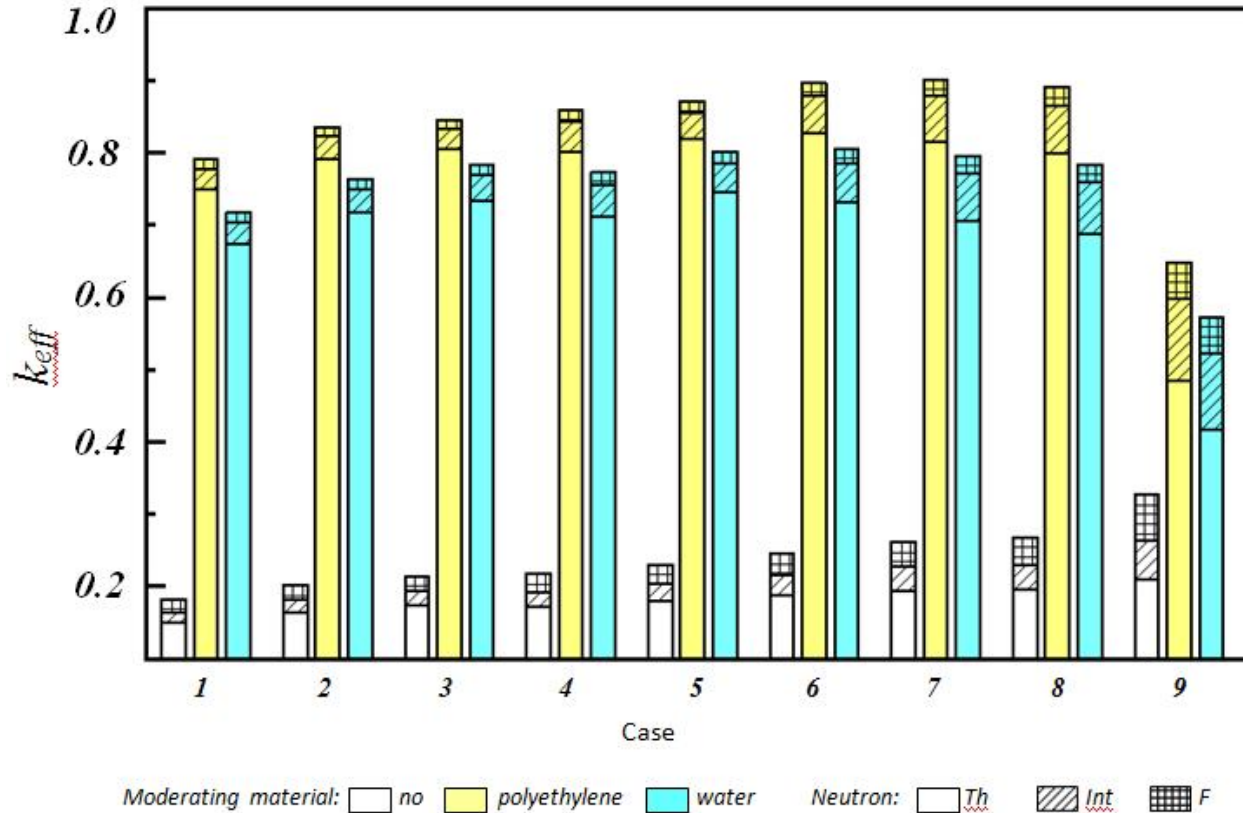


Fig. 7. Calculated k_{eff} values for different fuel rods configurations with a) no b) water and c) polyethylene moderating materials.

The Figure shows also the contribution of each range of neutron energy. All fuel rods studied cases were found to be subcritical. The maximum k_{eff} values were obtained for the cases P6, P7 and P8 at which k_{eff} approaches 0.9. This corresponds to ^{235}U masses between 1.7 and 2.2 kg. However all cases are still subcritical. The trend of k_{eff} increase and then decrease as the mass of fissile material increases (in cases of moderating material exist) is described before. Maximum k_{eff} values were obtained for the case of using polyethylene as moderating material as long as it contains more hydrogen atoms in a given volume than any other substance [22].

5. CONCLUSION

A criticality study has been conducted for the measurement of LEU samples using the AWCC. Fifty three cases were studied including dry and water contained powder samples, compact samples and fuel rods. All samples under this study could be safely measured in the AWCC with and without moderating materials in the cavity of the counter. The only exception was found for some NM-water mixtures contained U_3O_8 powder. For these samples the system becomes critical for masses ranges between 1.5 and 8 kg of ^{235}U with weight percent water in samples between 67 and 25.

REFERENCES

1. International Atomic Energy Agency. Statistical Concepts and Techniques for IAEA Safeguards, 5th ed, IAEA/SG/SCT/5, 1998.

2. Menlove HO. Description and operation manual for the active well coincidence counter. LA-7823-M, LANL, 1979.
3. Reilly TD, Ensslin N, Smith HA, Kreiner S. Passive nondestructive assay of nuclear materials, NUREG/CR-5550, LAUR-90-732, LANL, United States Nuclear Regulatory Commission, 1991.
4. Young BM, Lacy JL, Athanasiades A, Estimation of performance of an Active Well coincidence counter equipped with boron-coated straw neutron detectors, Waste Management Conf.: International collaboration and continuous improvement; Phoenix, AZ, USA 24-28 Feb 2013.
5. Ferrari F, P Paolo. Performance of an active well coincidence counter for HEU samples. Radiat Meas. 2010;45 (9):1034-43.
6. Goddard B, Charlton W, Peerani P. First principle active neutron coincidence counting measurements of uranium oxide. Nucl Instrum Methods Phys Res A. 2014;739:1-5.
7. Paff MG, Monterial M, Marleau P, Kiff S, Nowack A, Clarke S, Pozzi S. Gamma/neutron time-correlation for special nuclear material detection – active simulation of highly enriched uranium. Ann Nucl Energy. 2014;72:358-66.
8. Ahn SK, Lee TH, Shin HS, Kim HD Simulation and preliminary experimental results for an active neutron counter using a neutron generator for a fissile material accounting, Nucl Instrum Methods Phys Res A. 2009;609:205–12.
9. Krick MS, Menlove HO, Zick J, Ikonomou P, Measurement of enriched uranium and uranium-aluminum fuel materials with the AWCC, LA-10382-MS, LANL, 1985.
10. Wenz TR, Menlove HO, Walton G, Baca J, Design and calibration of the AWCC for measuring uranium hexafluoride, LA-12992, LANL, 1995.
11. Lu MS, Teichmann T, Upton NY, Ceo RN, Collins LL. Analysis of active well coincidence counter measurements. JNMM. 1994;22 (3):32-7.
12. Hartwell JK, McLaughlin GD. Non-destructive analysis of impure HEU-carbon samples using an active well coincidence counter (AWCC) 39, INMM Annual Meeting, Naples, FL, 26–30 July 1998.
13. Jensen BA, Sanders J, Wenz T, Buchheit R. Results of active well coincidence counter cross-calibration measurements at Argonne National Laboratory-West. ANL-02/35, Argonne, 2002.
14. Menlove HO, Siebelist R, Wenz TR. Calibration and performance testing of the IAEA Aquila active well coincidence counter (Unit 1). LA-13073-MS, LANL, 1996.
15. El-Gammal W, Zidan WI, Elhakim E. A proposed semi-empirical method for ^{235}U mass calibration of the active-well neutron coincidence counter. Nucl Instrum Methods Phys Res A. 2006; 565:731–41.
16. El-Gammal W, Ahmed GM, Mootaz E. On the Mathematical Calibration of the Active Well Neutron Coincidence Counter (AWCC). Am J Phys Appl. 2015; 3(4):121-30.
17. Reilly D, Krick M, Bosler G. Criticality Safety Consideration for HEU Measurements in AWCC. N-1-87-181, LANL, 1987.
18. Reilly D. Uranium-Oxide Calibration Experiment. N-1-90-101, LANL, 1990.

- 377
378 19. Miller MC, Yearwood DD. Criticality Study of Various Highly Enriched Uranium Samples in an
379 Active Well Coincidence Counter, LA-12837-MS, LANL, 1994.
380
381 20. X-5 Monte Carlo Team, MCNP - A General Monte Carlo N Particle Transport Code, Version 5,
382 Volume I: Overview and Theory, LA-UR-03-1987 (Revised 10/3/05), April 24, 2003.
383
384 21. X-5 Monte Carlo Team, MCNP - A General Monte Carlo N Particle Transport Code, Version 5,
385 Volume II: User's Guide, LA-CP-03-0245 (Revised 10/3/05), April 24, 2003.
386
387 22. Dewberry RA, Salaymeh SR, Mitigation of Neutron Background Hazard in F-Wing of SRTC,
388 Westinghouse Savannah River Company, WSRC-TR-2000-00179, 2000.
389

390
391
392 **ABBREVIATIONS**
393

394	LEU:	Low Enriched Uranium
395	AWCC:	Active Well Neutron Coincidence Counter
396	ENRRA:	Nuclear and Radiological Regulatory Authority
397	NM:	Nuclear Material
398	<i>ℓ</i> :	Liter
399	HEU:	High Enriched Uranium
400	D_T :	Theoretical density
401	D_h :	half theoretical density
402	D_f :	full theoretical density